
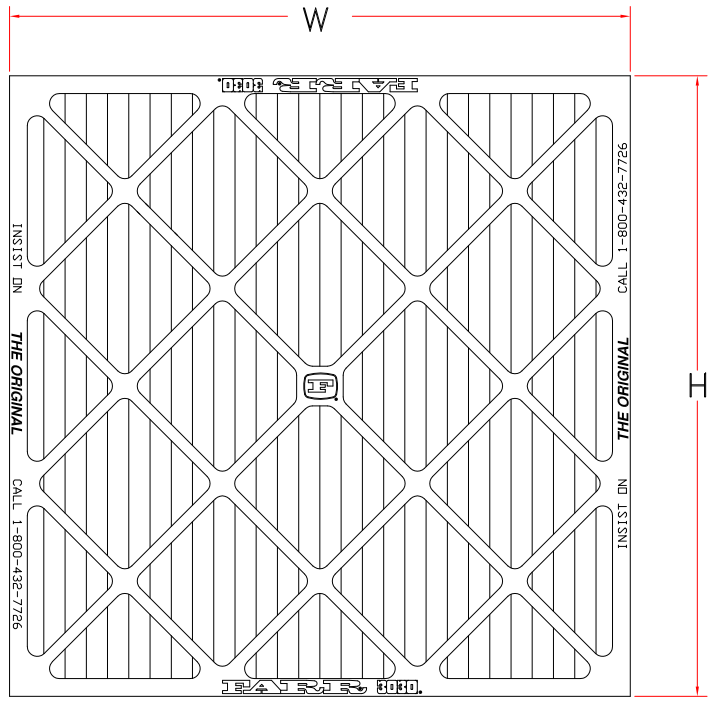


NOMINAL SIZE (INCH)	ACTUAL SIZE		ORDERING REFERENCE	AIRFLOW CAPACITY (CFM)	MEDIA AREA (SQ FT)	WEIGHT (LBS)
	H	W				
20 X 16 X 2	19.50	15.50	074181001	1110	9.9	1.13
20 X 20 X 2	19.50	19.50	074181002	1390	11.9	1.30
25 X 20 X 2	24.50	19.50	074181003	1740	14.9	1.65
25 X 16 X 2	24.50	15.50	074181004	1390	12.4	1.30
24 X 24 X 2	23.38	23.38	074181005	2000	17.3	1.80
24 X 12 X 2	23.38	11.38	074181006	1000	8.4	0.93
24 X 20 X 2	23.50	19.50	074181012	1670	14.3	1.55
24 X 18 X 2	23.50	17.50	074181015	1500	13.0	1.42
INITIAL PRESSURE DROP (IN. W.G.)			0.38			
FINAL PRESSURE DROP (IN. W.G.)			1.00			

NOMINAL SIZE (INCH)	ACTUAL SIZE		ORDERING REFERENCE	AIRFLOW CAPACITY (CFM)	MEDIA AREA (SQ FT)	WEIGHT (LBS)
	H	W				
24 X 24 X 4	23.38	23.38	074182001	2000	27.7	3.15
24 X 12 X 4	23.38	11.38	074182002	1000	13.9	1.65
20 X 20 X 4	19.38	19.38	074182003	1390	18.9	2.20
20 X 16 X 4	19.38	15.38	074182004	1110	15.7	1.80
25 X 16 X 4	24.38	15.38	074182005	1390	19.7	2.29
25 X 20 X 4	24.38	19.38	074182006	1740	23.6	2.80
24 X 18 X 4	23.38	17.38	074182007	1500	20.2	2.40
INITIAL PRESSURE DROP (IN. W.G.)			0.33			
FINAL PRESSURE DROP (IN. W.G.)			1.00			



GENERAL NOTES:

- MEDIUM EFFICIENCY, MERV 8 (25-30%) PANEL PLEATED DISPOSABLE. FILTER EFFICIENCY IS MINIMUM MERV RATING WHEN TESTED IN ACCORDANCE WITH ASHRAE 52.2-1999 AND MINIMUM DUST SPOT EFFICIENCY WHEN TESTED IN ACCORDANCE WITH ASHRAE 52.1-1992.
- AVAILABLE SIZES (NOMINAL) AND EFFICIENCIES: SEE TABULATION BLOCK.
- SEE CAMFIL FARR BULLETIN 1002-CL1-(LATEST REV.) FOR OTHER FEATURES, CONSTRUCTION AND PERFORMANCE CHARACTERISTICS.
- FILTER CLASSIFIED BY UNDERWRITERS LABORATORIES AS TO FLAMMABILITY ONLY U.L. CLASS 1.
- PHYSICAL DATA (MATERIAL OF CONSTRUCTION):
 - FRAME: HIGH WET-STRENGTH BEVERAGE BOARD WITH DIAGONAL SUPPORT MEMBERS.
 - MEDIA: HIGH DENSITY BLOWN GLASS MICRO FIBERS LAMINATED TO AN ALL GLASS SCRIM BACKING.
- ORDERING INSTRUCTIONS: SPECIFY BY NAME, MEDIA TYPE (EFFICIENCY), U.L. CLASS, NOMINAL SIZE (HxWxD) AND ORDERING REFERENCE.
 EXAMPLE:
 30/30 U.L. CLASS 1, SIZE 24x24x2, P/N 074181005
 30/30 U.L. CLASS 1, SIZE 24x18x4, P/N 074182007.
- FILTER THICKNESS:
 2" NOMINAL = 1.75" ACTUAL
 4" NOMINAL = 3.75" ACTUAL

PERFORMANCE NOTES:

- SEE TABULATION BLOCK FOR PRESSURE DROP (INITIAL AND FINAL) AND AIRFLOW CAPACITY. PERFORMANCE TOLERANCE IS IN ACCORDANCE WITH AIR STANDARD 850, SECTION 7.4.
- CAMFIL FARR RECOMMENDS FILTER TO BE INSTALLED WITH THE PLEATS RUNNING PARALLEL TO HEIGHT DIMENSION.
- OPERATING TEMPERATURE:
 - CONTINUOUS = 200°F
 - INTERMITTENT = 220°F
- SEE RESISTANCE VERSUS AIRFLOW BULLETIN 1002-CL1-IRVA (LATEST REV.) FOR VARIOUS AIRFLOW CAPACITIES.

H	02/25/09	REVISED	14955-AX	SMA	-	-
A	08/15/72	FIRST ISSUE	7680-N	-	-	-
REV	DATE	DESCRIPTION	EWD	DFT	CK	APP



© Camfil Farr <http://www.camfilfarr.com>

DESCRIPTION
 30/30 CL1 FILTER
 25-30%
 1.75 & 3.75 THICK

SHEET	DRAWING NUMBER	REV
1 OF 1	074201	H